

Tender No:
KDUSC/PRO/MAINT/081/2021

M/S.....
.....
.....



General Sir John Kotelawala Defence University,
Southern campus, Edison Hills,
Nugegalayaya, Sewanagala, Sri Lanka.
Adjutant 0473624894
Procurement Officer 0473624893
Fax 0473620811
www.kdu.ac.lk

05 May 2021

INVITATION TO BID AND GENERAL CONDITIONS OF TENDER

1. The Rector of the General Sir John Kotelawala Defence University – Southern Campus, as the Chairman, Department Procurement Committee invites Bid/s from prospective Bidders for supply of **items listed and specifications of the items are indicated in Annex “A”.**

2. **CLOSING DATE & TIME.** The tender will close at 1000hrs on 20/05/2021. Any Bid submitted after the closing time of the tender will be rejected & unopened such bids will be returned to the bidder.

3. **VALIDITY OF BID.** The bid submitted under this tender **must be valid for a period of 120 days from the date of closing of tender.**

4. **VALUE ADDED TAX.** The Bidders who bid for locally delivered items must have the VAT registration. The VAT portion must be shown separately in the price schedule in Annex “A” and VAT registration number must be indicated. If the quoted item is exempted from VAT or Bidding Company is not liable for VAT, reference number and date of relevant Act number/Gazette notification/a certificate (as applicable) **issued for the current financial year** from the Commissioner General of Inland Revenue to that effect should be submitted along with the Bid.

5. **BID SUBMISSION.** The **bidder must duly sign at the last page (before Annexes) of this document** indicating the name of the signatory and the name of the company & place the company common seal to confirm the acceptance of tender conditions. **The Bid/s that do not include authorized signature will be rejected.** The Bid/s duly signed by the bidder enclosed and sealed in an appropriate cover addressed to the following address should be sent by registered post or could be deposited in the **appropriate tender box placed at General Sir John Kotelawala Defence University- Southern Campus, Edison Hills, Nugegalayaya, Sewanagala.** (at the Main Entrance of General Sir John Kotelawala Defence University) on or before the time & date specified for the closing of tender. **The tender reference number, date & time of closing tender should be indicated & underlined at the top left corner of the envelop.**

6. **BID OPENING.** All duly received bids **will be opened immediately after the scheduled closing time of Bids at the same venue.** Bidders or their accredited agents could be present at the time of opening of bids.

7. **PRICES.** For locally delivered items (including locally manufactured items & foreign items imported by the bidders) price must be quoted in Sri Lankan Rupees, inclusive of all charges for delivery of items to General Sir John Kotelawala Defence University- Southern Campus stores at Sewanagala. **Unit price, VAT and Total price should be clearly indicated in schedule in Annex “A”.**

8. **DELIVERY.** Preference will be given for early delivery. In case of bulk supplies for locally manufactured items, the delivery of **total quantity must be completed within 120 days of signing of contract,** unless mutually agreed for extended delivery period with General Sir John Kotelawala Defence University. **The bidder/s must indicate the proposed delivery schedule in Annex “E”.** In the event of placing a purchase order with the successful bidder, the total quantity so ordered must be supplied as one consignment unless part deliveries are agreed upon in the contract. The deliveries not made as per agreed delivery schedule will be considered as bad performances by the suppliers and **no extended delivery period will be authorized.**

9. **PAYMENT TERMS FOR LOCALLY DELIVERED ITEMS.** Payment will be made after acceptance of items which should be subjected to a pre-acceptance inspection/testing by General Sir John Kotelawala Defence University authorities. Any item that does not confirm to the specifications or already approved sample will be rejected & it is the responsibility of the supplier to remove them from General Sir John Kotelawala Defence University stores/premises within 07 working days of such intimation (either verbal or written) at his own cost and replace them with items conforming to specification within one month of such rejection.

10. Special Instruction SAMPLES/PAYMENT OF TESTING CHARGES.

When it is required to submit samples, **every offer** must be accompanied with pre - marked samples. The marking of samples **indicating the Bidder & Offer number** must be done and the samples must be handed over to the officer at same place where tender box is placed **on or before the closing date & time of the Bid.** Samples submitted after closing time of the Bid will be rejected. When the testing charges are required to be paid, bidders shall pay testing charges separately **for all offers** indicated in their bid/s.

- (i) **Samples.** Please submit..... Samples.
- (ii) **Testing Charges.** A sum of Rs. **per offer** must be paid to the Assistant Bursar of KDU, prior to the submission of bid and a copy of the receipt must be annexed to the bid. It is the responsibility of bidder to inform the Cashier of the Account Office to note the tender number on the receipt issued for such payments.

11. **RIGHTS OF THE PROCUREMENT COMMITTEE.** The General Sir John Kotelawala Defence University – Southern Campus Procurement Committee reserve the right to **accept or reject** whole or part of this tender and their decision will be final. The successful bidders will be notified. Information with regard to rejected or unsuccessful bids will not be communicated.

Thanking You,
Yours Faithfully,



For Recton
General Sir John Kotelawala Defence University
Southern Campus

I/We agree to abide by the conditions of tender and undertake to supply the items as per delivery schedule mentioned in the contract, in the event of an order been placed with me/my firm/company as a result of this tender.

.....
Signature

.....
Name of Signatory

NIC:.....

.....
Name of the Company/Bidder

Date :-

Company seal:

SR/ NO	Description	Denomination of Qty	Qty Required	Country/ Brand Or Origin	Unit Price	Total Price
	<u>PURCHASE LED LIGHTS AND FITTINGS FOR CONSTRUCTION OF BACHELOR QUARTERS BUILDING (STAGE II)</u>					
01	LED chandelier lamp 6 pcs 7W (Specification Attached As Annex "B")	No's	01			
02	LED surface mount S/Q type 18W 300x300x34mm (Specification Attached As Annex "C")	No's	12			
03	LED in door type wall lamp 7W (Specification Attached As Annex "D")	No's	01			
04	LED out door type wall lamp 7W (Specification Attached As Annex "E")	No's	04			
05	LED mirror lamp with switch 7W (Specification Attached As Annex "F")	No's	14			
06	LED decorative pendent lamp 12W (Specification Attached As Annex "G")	No's	14			
07	Fan dimmer with switch	No's	18			
08	MCB 2 pole 40 A (isolator) (Specification Attached As Annex "H")	No's	04			
09	RCCB 40A 30mA 2 pole (Specification Attached As Annex "I")	No's	04			
10	MCB 16 A Single pole (Specification Attached As Annex "J")	No's	22			
11	Ceiling fan (Specification Attached As Annex "K")	No's	18			
	Note:					
	Tax: (If Any)					
	VAT: (08%)					
	Grand Total:.....					
	Warranty:.....					
	Make Model & Country					
	* Please Indicate The Unit Price After All Possible Discount.					
	* Past experiences are to be mentioned					

- I. Validity of Offer
 II. Delivery Period
 III. Credit Period
 IV. Discount if any
 V. Ex- Stock availability


.....
 Rubber Stamp of the Firm

.....
 Signature of Authorized Officer

Name:.....
 T/Phone No:.....
 E mail :

Registration No:.....


KDU-SC/BQ/STAGE II/ELE/2021/02

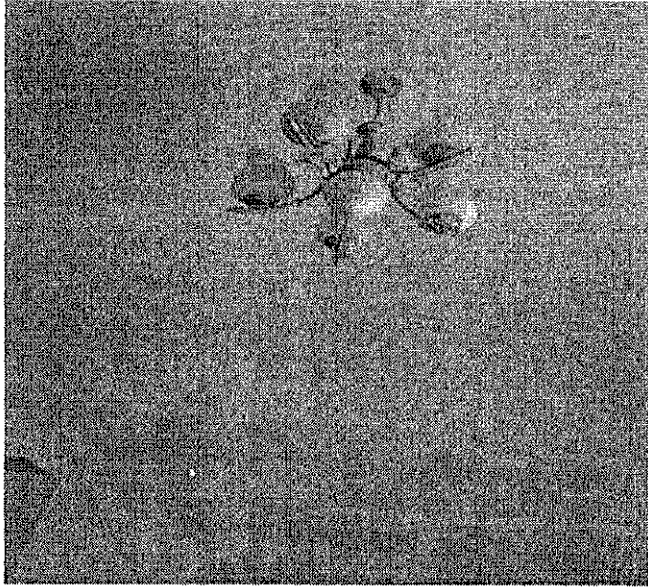02. Specifications chandelier lamp (S/No: 01)


- | | | |
|-----------------|----|----------------------------|
| a) Power Supply | :- | 230VAC, 50Hz, single phase |
| b) wattage | :- | 7W |
| c) Type | : | chandelier lamp |
| d) Materials | : | metal, stained glass |
| e) Style | : | <u>Traditional</u> |
| f) Warranty | :- | min. 01 year |

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)

- (1) Quoted item shall be compliance with SLSI
- (2) OEM authorization details as authorized distribute for the quoted item
- (3) Reputed brand from original suppliers
- (4) Preference will be given for the local manufactures and extended warranty period
- (5) Possible discount are to be indicated during the initial bidding process


 H.M.P. Gunaratne
 Lieutenant (CB) NRC 3096
 Civil Engineer
 Sri Lanka Navy


KDU-SC/BQ/STAGE II/ELE/2021/02

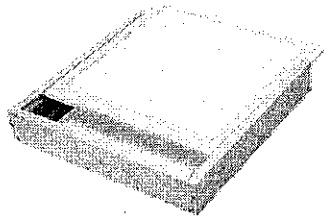05.Specifications surface mount S/Q type lamp 18W (S/No: 02)

- a. Power Supply :- 230VAC, 50Hz, single phase
b. Type :- As in image or hanging type
d. Lighting type :- LED
e. Rated power :- 18W
f. Rated color :- 6500k
d Warranty :- min. 02 year

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)


- (1) Quoted item shall be compliance with SLSI
- (2) OEM authorization details as authorized distribute for the quoted item
- (3) Reputed brand from original suppliers
- (4) Preference will be given for the local manufactures and extended warranty period
- (5) Possible discount are to be indicated during the initial bidding process


H M P Gunarathna
Lieutenant (CB) NRC 309,
Civil Engineer
Sri Lanka Navy

KDU-SC/BQ/STAGE II/ELE/2021/02


07. Specifications LED indoor type wall lamp 03

- q) Power Supply :- 230VAC, 50Hz, single phase
r) wattage :- 7W
s) Type :- As in image or similar type
t) Width :- 2'
u) Warranty :- min. 01 year

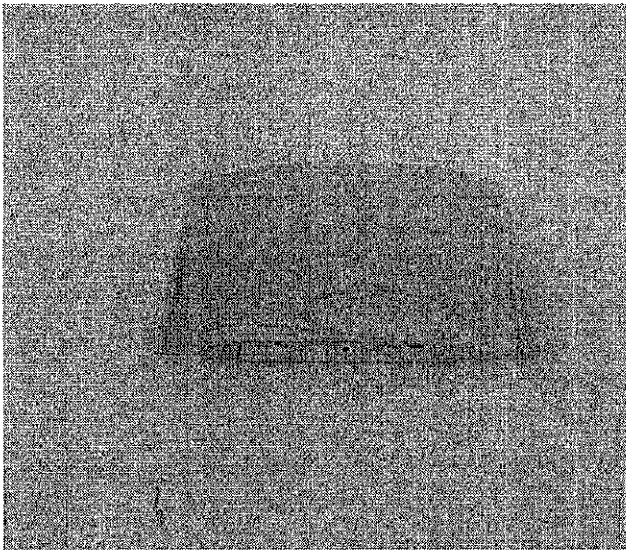

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)


- (1) Quoted item shall be compliance with SLSI
- (2) OEM authorization details as authorized distribute for the quoted item
- (3) Reputed brand from original suppliers
- (4) Preference will be given for the local manufactures and extended warranty period
- (5) Possible discount are to be indicated during the initial bidding process


H M P Gunarathne
Lieutenant (CE) NRC 3020
Civil Engineer
Sri Lanka Navy

KDU-SC/BQ/STAGE II/ELE/2021/02


06. Specifications LED Out door type wall lamp (S/No: 04)

- l) Power Supply :- 230VAC, 50Hz, single phase
m) wattage :- 7W
n) Type :- As in image or similar type
o) Width :- 2'
p) Warranty :- min. 01 year

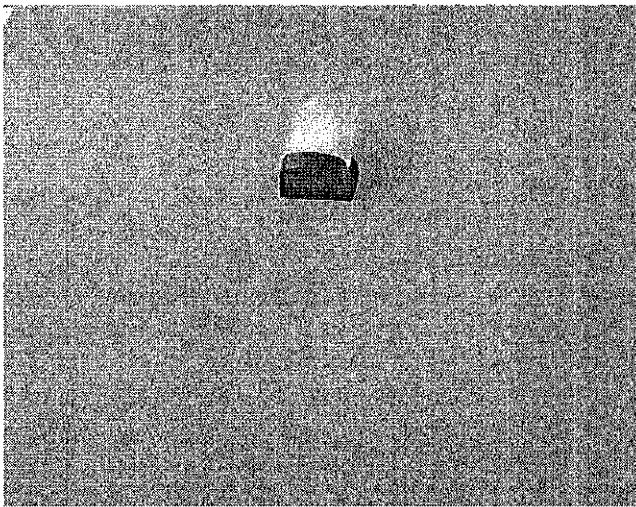

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)


- (1) Quoted item shall be compliance with SLSI
- (2) OEM authorization details as authorized distribute for the quoted item
- (3) Reputed brand from original suppliers
- (4) Preference will be given for the local manufactures and extended warranty period
- (5) Possible discount are to be indicated during the initial bidding process


H M P Gunarathna
Lieutenant (CB) NRC 3693
Civil Engineer
Sri Lanka Navy

KDU-SC/BQ/STAGE II/ELE/2021/02


03. Specifications fittings complete LED mirror lamp (S/No: 11) 05

- g) Power Supply :- 230VAC, 50Hz, single phase
 h) wattage :- 7W
 i) Type :- As in image or similar type
 j) Width :- 2'
 k) Warranty :- min. 01 year

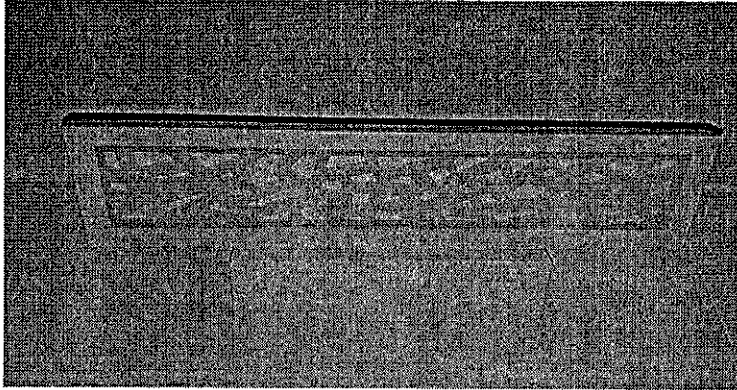


Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)

- (1) Quoted item shall be compliance with SLSI
- (2) OEM authorization details as authorized distribute for the quoted item
- (3) Reputed brand from original suppliers
- (4) Preference will be given for the local manufactures and extended warranty period
- (5) Possible discount are to be indicated during the initial bidding process


 H.M.P. Gunarathna
 Lieutenant (CE) NRC 302
 Civil Engineer
 Sri Lanka Navy


KDU-SC/BQ/STAGE II/ELE/2021/02

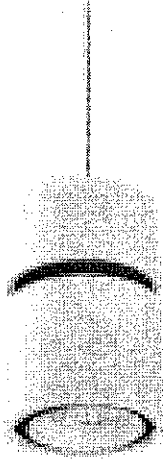04. Specifications decorative pendant lamp 06

- a. Power Supply :- 230VAC, 50Hz, single phase
- b. Type :- As in image or hanging type
- c. Lighting type :- LED
- d. Warranty :- min. 01 year

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)


- (1) Quoted item shall be compliance with SLSI
- (2) OEM authorization details as authorized distribute for the quoted item
- (3) Reputed brand from original suppliers
- (4) Preference will be given for the local manufactures and extended warranty period
- (5) Possible discount are to be indicated during the initial bidding process


 H M P Gunarathna
 Lieutenant (CE) NRC 3698
 Civil Engineer
 Sri Lanka Navy

KDU-SC/BQ/STAGE II/ELE/2021/02

10. Specification for MCB 2 pole 40A (S/N 08)

a) Circuit Breaker Type	:-	MCB
b) Voltage	:-	230VAC,50Hz
c) Required standard	:-	BS 4752-1:1977
d) Current Rating	:-	40A
e) Number of poles	:-	Two Pole
f) Breaking capacity	:-	15KA
g) Rated impulse with stand voltage to EN/IEC 60947-2	:-	6 kV conforming
h) Warranty	:-	Life time
i) Mechanical durability	:-	more than 1800cycles
j) Electrical durability	:-	more than 1800cycles
k) IP degree protection	:-	IP 20 conforming to IEC 60529
l) Operation temperature	:-	-30...70 °C
m) Storage temperature	:-	-40...85 °C

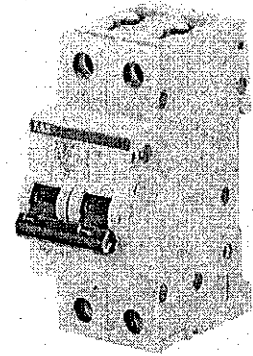

Note: Quoted item shall be compliance with SLSI
OEM authorization details as authorized distribute for the quoted item
ABB or equivalent preferred

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)

H M P Gunarathna
Lieutenant (CE) NRC 30x
Civil Engineer
Sri Lanka Navy

KDU-SC/BQ/STAGE II/ELE/2021/02

11. Specification for RCCB 2pole 40A30Ma (S/N 09)

a) Circuit Breaker Type	:-	RCCB
b) Voltage	:-	230VAC,50Hz
c) Required standard	:-	BS 4293:1983
d) Current Rating	:-	40A
e) Number Of Poles	:-	Two Pole
f) Warranty	:-	Life time
g) Earth leakage sensitivity	:-	30 mA
h) Leakage protection time	:-	Instantaneous
i) Earth leakage protection	:-	Type I
j) Mechanical durability	:-	5000 cycles
k) Electrical durability	:-	2000 cycles
l) Relative humidity	:-	95 % at 55 °C
m) IP protection	:-	IP20 conforming to IEC 60529
n) Rated short circuit current	:-	Inc 10 kA 125 A
o) Rated breaking & making		
▪ Capacity	:-	Im = 1250 A 230 V conforming to IEC 61008



Note: Quoted item shall be compliance with SLSI OEM authorization details as authorized distribute for the quoted item
ABB or equivalent preferred

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)

H M P Gunarathna
Lieutenant (CE) NRC 369
Civil Engineer
Sri Lanka Army

KDU-SC/BQ/STAGE II/ELE/2021/02

09. Specification for MCB single pole 6A /10A/16A/32A (S/N 10)

h. Circuit Breaker Type :-	MCB
i. Voltage :-	230VAC,50Hz
j. Required standard :-	BS 3871-1:1965
k. Current Rating :-	6A /10A /16A/32A
l. Number of poles :-	Single Pole
m. Warranty :-	Life time
n. Breaking capacity :-	15KA
o. Rated impulse with Stand voltage :-	6 kV conforming to EN/IEC 60947-2
p. Mechanical durability :-	more then 1800cycles
q. Electrical durability :-	more then 1800cycles
r. IP degree protection :-	IP 20 conforming to IEC 60529
s. Operation temperature:-	-30...70 °C
t. Storage temperature :-	-40...85 °C



Note: only preferred reputed brands and required OEM authorization details as authorized distribute for the quoted item
ABB or equivalent preferred


Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory- if not indicated / provided offer will be rejected)

H M P Gunarathna
Lieutenant (CB) NRC 309...
Civil Engineer
Sri Lanka Navy

KDU-SC/BQ/STAGE II/ELE/2021/02

01.Specification for ceiling fan with dimmer (S/No: 11)

- | | | |
|-----------------|----|------------------------|
| a. Voltage | :- | 230VAC,50Hz |
| b. Wattage | :- | 75W |
| c. Length | :- | 56" |
| d. Warranty | :- | min. 01 year |
| e. Blade | :- | Powder quoted aluminum |
| f. Noise Level | :- | <62Db |
| g. Bearing type | :- | Double bearing |

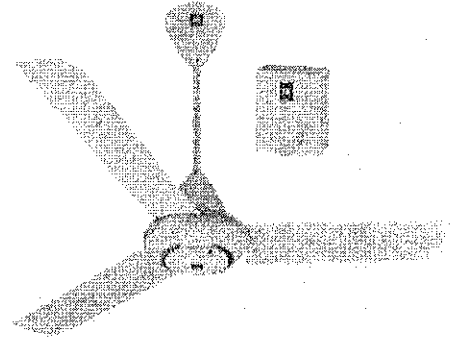

Note: Supplier to indicated / provide under mentioned details along with the quotation and confirm each and every specification mentioned above by putting signature and rubber seal on the specification sheet. Make / Model / country of origin (Mandatory-if not indicated / provided offer will be rejected)

- (1) Quoted item shall be compliance with SLSI
- (2) OEM authorization details as authorized distribute for the quoted item
- (3) Reputed brand (KDK or equivalent) from original suppliers
- (4) Preference will be given for the local manufactures and extended warranty period
- (5) Possible discount are to be indicated during the initial bidding process

H M P Gunarathna
Lieutenant (CE) NRC 3698
Civil Engineer
Sri Lanka Navy